


COOLER PIPE BANKS SHOWN WITHDRAWN



COOLER PIPE BANKS SHOWN WITHDRAWN

ITEM No.	QTY.	DESCRIPTION
1	1	VD9 - ATTRITION UNIT [2000x2000 DECK]
2	1	VD9 - DUST HOOD
3	1	VE9 - LADDER
4	1	T15 - COOLER CLASSIFIER
5	1	EXTRACTION DUCTING
6	1	PA3 - PNEUMATIC CONVEYOR
7	1	PNEUMATIC CONVEYOR PIPEWORK
8	1	WATER PIPEWORK
9	1	WATER COOLING TOWER
10	1	WATER PUMP
11	1	CONTROL PANEL
12	1	EXTRACTOR

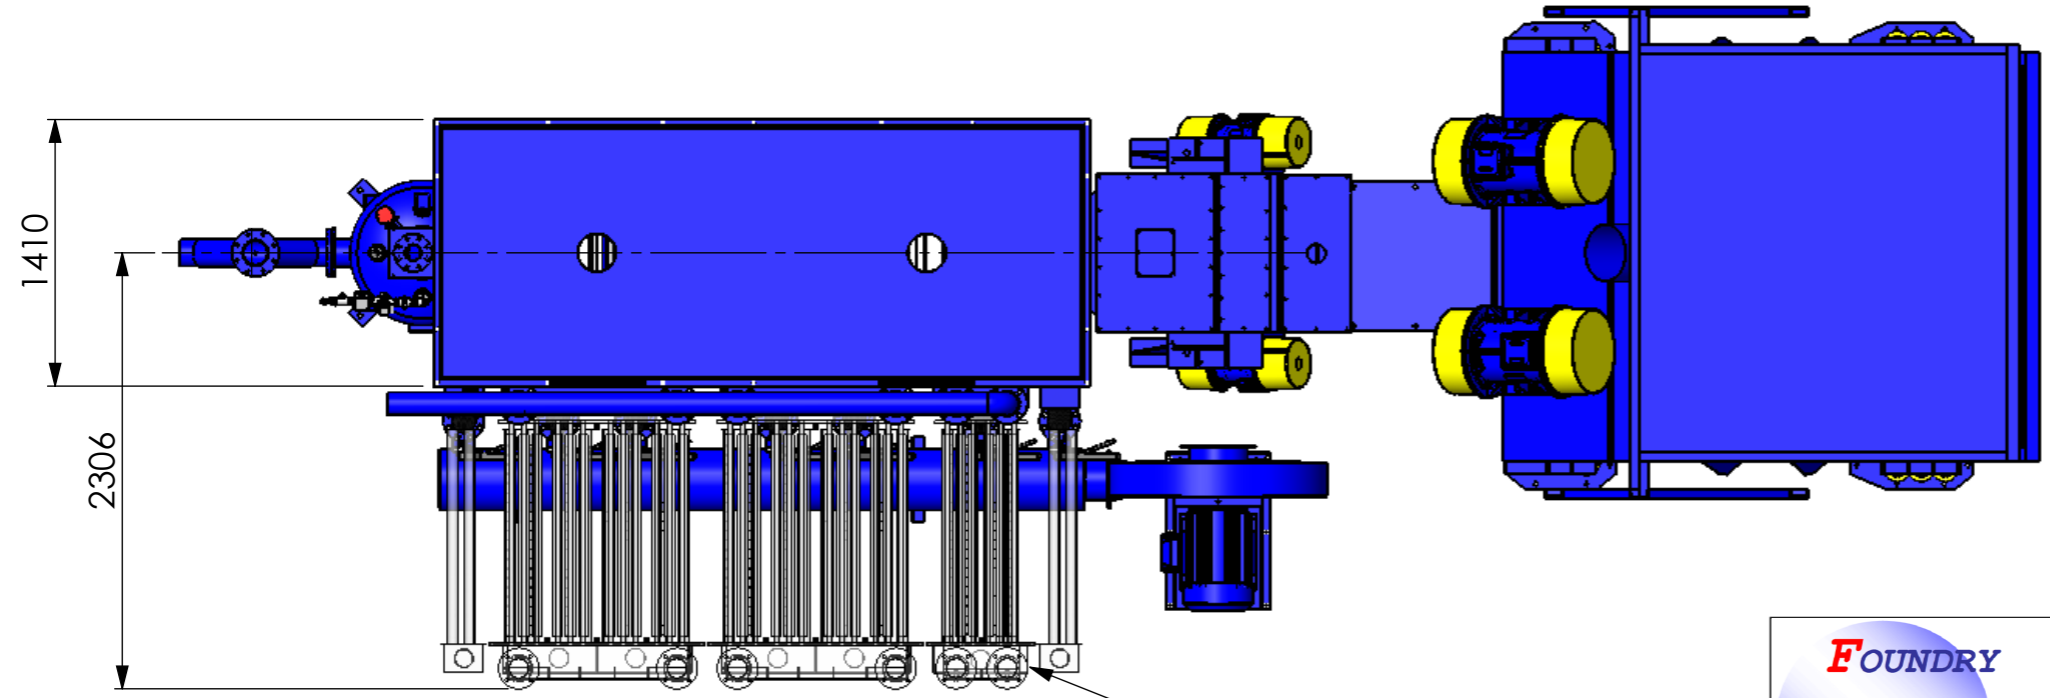

Unit H, Fryers Close, Walsall, West Midlands. WS3 2XQ  
Phone +44 (0)1922 493603 Fax +44 (0)1922 713729

TITLE: G.A. OF RECLAMATION PLANT [ VD9 / VE9 / T15 / PA3 ]		
SHEET SIZE. A3	SCALE: 1:40	REVISION
DRAWING No. R102404		